








OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT							CONTRACTOR  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 	
MC:   شرکت مهندسی و پیمانکاری دانشگاه بوشهر	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)							Contract No :	
Owner Document Number :	BU	20	VD	303	ME	DSH	0075	rev 00	Page: 1 OF 20


MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)

00	12/08/2021	for approval	KP	KP	JR		
Rev.	Date	Description	Prepared By	Checked By	Approved		AC code.

OWNER:  **BUSHEHR PETROCHEMICAL COMPANY**
MEG PLANT

CONTRACTOR:  Chagalesh-Enerchimi-Steam
Joint Venture
BUPC-MEG PLANT PROJECT

MC:   **MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)**



Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No :
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 3 OF 20

Owner Document Number : BU 20 VD 303 ME DSH 75 Rev : 00 Page: 3 OF 20

1 APPLICABLE TO: PROPOSALS PURCHASE AS BUILT

2 FOR/USER BUPC SITE/LOCATION ASSALUYEH SERVICE EMERGENCY INSTRUMENT AIR COMP NO. REQ'D ONE SET 1(STAGE)

3 NOTE: INDICATES INFO. TO BE COMPLETED BY PURCH. BY MANUFACTURER WITH PROPOSAL BY MANUFACTURER AFTER ORDER BY MANUFACTURER OR PURCHASER AS APPLICABLE

4

5 COMPR. MFGR Airpack TYPE MODEL NO(S) SERIAL NO(S) TBD

6 COMPR. THROWS: TOTAL NO. 1 NO. WITH CYLS. 1 NOMINAL FRAME RATING 15 BkW @ RATED RPM OF 400

7 MAX/MIN ALLOWABLE SPEED 690 / 400 RPM

8 DRIVER MFGR. WEG DRIVER NAMEPLATE kW/OPERATING RPM 15 kW / 3000

9 DRIVE SYSTEM: DIRECT COUPLED GEARED & COUPLED V-BELT

10 TYPE OF DRIVER: IND. MOTOR SYN. MOTOR STEAM TURBINE GAS TURBINE ENGINE OTHER

11 NO NEGATIVE TOLERANCE APPLIES: YES - PURCHASER TO FILL IN "REQUIRED CAPACITY" LINES. CYLINDERS: LUBE


12 (NNT) NO - PURCHASER TO FILL IN "MFGR.'S RATED CAP." LINES NON-LUBE



13 MAX ACCEPTABLE AVG PISTON SPEED 3.5 m/s

14 **OPERATING CONDITIONS (EACH MACHINE)**

15 <input checked="" type="radio"/> OPERATING CASE	1								
16 <input checked="" type="radio"/> STAGE	1								
17 <input type="radio"/> SIMULATION BASIS									
18 <input checked="" type="radio"/> NORM. OR ALT. CONDITION	Norm								
19 <input checked="" type="radio"/> CERTIFIED PT. (X) MARK ONE									
20 <input checked="" type="radio"/> MOLECULAR WEIGHT	29								
21 <input checked="" type="radio"/> Cp/Cv (K) @ 65°C OR	1.4								
22 <input checked="" type="radio"/> INLET CONDITIONS:	AT INLET TO: <input checked="" type="radio"/> PULSE DEVICES <input type="radio"/> COMPRESSOR CYLINDER FLANGES								
	NOTE: <input type="radio"/> SIDE STREAM TO STAGE(S), THESE INLET PRESS. ARE FIXED								
23 <input checked="" type="radio"/> PRESSURE @ PUL. SUPP. INLET (bara)	8 (Min.:7, Max:8.5)								
24 <input type="checkbox"/> PRESSURE (Bara) @ CYL. FLANGE	8 (Min.:7, Max:8.5)								
25 <input checked="" type="radio"/> TEMPERATURE (°C)	AMB.(Min.:10, Max.:45)								
26 <input type="radio"/> INLET Cp/Cv	1.4								
27 <input checked="" type="radio"/> COMPRESSIBILITY (Z _s)	1								
28 <input checked="" type="radio"/> INTERSTAGE: INTERSTAGE Δ P INCL. <input checked="" type="radio"/> PULSE DEVICES <input checked="" type="radio"/> PIPING <input checked="" type="radio"/> COOLERS <input checked="" type="radio"/> SEPARATORS <input type="radio"/> OTHER									
29 <input type="checkbox"/> Δ P BETWEEN STAGES, % / BAR	/	/	/	/	/	/	/	/	/
30 <input checked="" type="radio"/> DISCHARGE CONDITIONS:	AT OUTLET FROM: <input checked="" type="radio"/> PULSE DEVICE <input type="radio"/> COMP. CYL. FLANGES <input type="radio"/> OTHER								
31 <input type="checkbox"/> PRESSURE @ CYL. FLANGE (bara)	8 (Min.:7, Max:8.5)								
32 <input checked="" type="radio"/> PRESS. (bara) @ PUL. SUPP. OUTLET	21								
33 <input type="checkbox"/> TEMP., ADIABATIC, °C	164								
34 <input type="checkbox"/> TEMP., PREDICTED, °C	180								
35 <input type="checkbox"/> COMPRESSIBILITY (Z ₂) OR (Z _{AVG})	0,04								
36 <input checked="" type="radio"/> * REQUIRED CAPACITY, RATED FOR PROCESS, AT INLET TO COMPRESSOR, NO NEGATIVE TOLERANCE (-0%)									
37 <input checked="" type="radio"/> kg/h CAPACITY SPECIFIED	55								
38 <input type="radio"/> WET <input checked="" type="radio"/> DRY									
39 <input type="radio"/> m³/h (760 mm HG & 0°C)	43								
40 <input checked="" type="radio"/> * MFGR.'S RATED CAPACITY (AT INLET TO COMPRESSOR) & kW @ CERTIFIED TOLERANCE OF ±3% FOR CAP. & ±3% FOR kW									
41 <input type="checkbox"/> kg/h CAPACITY SPECIFIED	223								
42 <input type="radio"/> WET <input checked="" type="radio"/> DRY									
43 <input type="checkbox"/> INLET m³/h	173								
44 <input type="checkbox"/> Nm³/h	173								
45 <input type="checkbox"/> kW/STAGE	11								
46 <input type="checkbox"/> ABSORBED POWER ESTIMATED, kW	12								
47 <input type="checkbox"/> TOTAL kW INCLUDING V-BELT & GEAR LOSSES	13								
48 <input checked="" type="radio"/> * CAPACITY FOR NNT									
49									
50									
51									

MANUFACTURER'S = REQUIRED ÷ 0.97
THEREFORE REQUIRED = MFR'S x 0.97

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Stream Joint Venture BUPC-MEG PLANT PROJECT 
---	--	---

MC:   شرکت مهندسی و پیمانکاری سازمان پیمانکاری	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	Contract No : 52-98/445					
Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445

Owner Document Number : BU 20 VD 303 ME DSH 75 Rev : 00 Page: 4 OF 20

1	GAS ANALYSIS AT OPERATING CONDITIONS						REMARKS
2	MOLE PERCENT						
3	<input checked="" type="radio"/> SERVICE/ITEM NO.						
4	<input checked="" type="radio"/> STAGE						
5	<input type="radio"/> NORMAL OR ALT						
6		M.W.	NORMAL				
7	AIR	28.966	100				
8	NITROGEN	28.016					
9	WATER H ₂ O	18.016					
10	CARBON MONOXIDE CO	28.010					
11	CARBON DIOXIDE CO ₂	44.010					
12	HYDROGEN H ₂	2.016					
13	METHANE CH ₄	16.042					
14	ETHANE	30.068					
15	PROPANE	44.094					
16	i-BUTANE	58,12					
17	n-BUTANE	58,12					
18	i-PENTANE	72,146					
19	OXYGEN O ₂	32.00					
20	HYDRO. SULFIDE	34,076					
21	ETHYLENE	28,052					
22	PROPYLENE	42,078					APPLICABLE SPECIFICATIONS
23	n-PENTANE	72,146					<input checked="" type="radio"/> API-618-RECIPROCATING COMPRESSORS
24	HEXANE PLUS						FOR PETROLEUM, CHEMICAL AND GAS
25	AMMONIA	17,031					INDUSTRY SERVICES
26	HYDRO. CHLORIDE	36,461					
27	CHLORINE	70,914					<input checked="" type="radio"/> Doc. No. 1216-DE-00-RE-MSS-302
28							
29							
30							
31	TOTAL:						
32	<input type="checkbox"/> CALCULATED MOL WT.		28,97				
33	<input type="checkbox"/> Cp/Cv (K) @ 65° OR	Suction temperature °C	45				
34	NOTE: IF WATER VAPOR AND/OR CHLORIDES ARE PRESENT, EVEN MINUTE						
35	TRACES, IN THE GAS BEING COMPRESSED, IT MUST BE INCLUDED ABOVE.						

SITE CONDITION (SEE PROJECT SITE CONDITION FOR MORE DETAIL)

ELEVATION	8,5 m	BAROMETER	(BARA)	AMBIENT TEMPS: MAX	55 °C	MIN	5 °C
		<input type="radio"/> MIN DESIGN METAL TEMP		5 °C (2.14.8)	RELATIVE HUMIDITY: MAX	NA	MIN NA %
COMPRESSOR LOCATION:	<input type="radio"/> INDOOR	<input type="radio"/> HEATED	<input checked="" type="radio"/> UNHEATED	<input checked="" type="radio"/> AT GRADE LEVEL	<input type="radio"/> ELEVATED:		M
	<input checked="" type="radio"/> OUTDOOR	<input type="radio"/> NO ROOF	<input checked="" type="radio"/> UNDER ROOF	<input type="radio"/> PARTIAL SIDES	<input type="radio"/> PLATFORM:	<input checked="" type="radio"/> ON-SHORE	
	<input type="radio"/> OFF-SHORE	<input checked="" type="radio"/> WEATHER PROTECTION REQ.		<input checked="" type="radio"/> TROPICALIZATION REQ.			
	<input type="radio"/> WINTERIZATION REQUIRED						
UNUSUAL CONDITIONS:	<input type="radio"/> CORROSIVES	<input checked="" type="radio"/> DUST	<input checked="" type="radio"/> FUMES	<input checked="" type="radio"/> OTHER	Sand storm , Thunder & Lightening, Sea Breeze		

ELECTRICAL CLASSIFICATIONS							
HAZARDOUS				NON-HAZARDOUS			
47	MAIN UNIT	<input checked="" type="radio"/> ZONE	2	GROUP	IIB	TEMP CLASS	T3
48	L.O. CONSOLE	<input checked="" type="radio"/> ZONE	2	GROUP	IIB	TEMP CLASS	T3
49	CW CONSOLE	<input type="radio"/> ZONE		GROUP		TEMP CLASS	
50							
51							
52							

OWNER:  **BUSHEHR PETROCHEMICAL COMPANY**
MEG PLANT

CONTRACTOR: 
Chagalesh-Enerchimi-Steam
Joint Venture
BUPC-MEG PLANT PROJECT

MC:   **MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT**
AIR COMPRESSOR (20-C-7080)



Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 5 OF 20

PART LOAD OPERATING CONDITIONS

CAPACITY CONTROL BY: MFG'S CAP. CONTROL PURCHASERS BY-PASS BOTH OTHER _____

FOR: PART LOAD COND. START-UP ONLY BOTH

WITH: AUTO LOADING DELAY INTERLOCK AUTO IMMEDIATE UNLOADING

USING: FIXED VOLUME POCK. SUCTION VALVE UNLOADERS: FINGER PLUG OTHER

ACTION: DIRECT (AIR-TO-UNLOAD) REVERSE (AIR-TO-LOAD/FAIL SAFE)

NUMBER OF STEPS: ONE THREE FIVE OTHER _____

RAIN COVER REQUIRED OVER UNLOADERS

ALL UNLOADING STEPS BASIS MANUFACTURERS CAPACITY SHOWN ON PAGE 1.

INLET AND DISCHARGE PRESSURE ARE	<input type="radio"/> AT CYLINDER FLANGES	<input checked="" type="radio"/> PULSATION SUPPRESSOR FLANGES
<input type="radio"/> SERVICE OR ITEM NO.		
<input type="radio"/> STAGE	1	
<input type="radio"/> NORMAL OR ALTERNATE CONDITION	Normal	
<input type="radio"/> PERCENT CAPACITY	100	
<input type="radio"/> WEIGHT FLOW, kg/h	223	
<input checked="" type="radio"/> m ³ /h (760 mm HG & 0°C)	173	
<input type="checkbox"/> POCKETS/VALVES OPERATION *		
<input type="checkbox"/> POCKET CLEARANCE ADDED %		
<input type="checkbox"/> TYPE UNLOADERS, PLUG/FINGER		
<input checked="" type="radio"/> INLET TEMPERATURE, °C	45	
<input checked="" type="radio"/> INLET PRESSURE, (BARA)	8 (Min.:7, Max:8.5)	
<input checked="" type="radio"/> DISCHARGE PRESSURE, (BARA)	21,5	
<input type="checkbox"/> DISCHARGE TEMP., ADIABATIC °C	164	
<input type="checkbox"/> DISCHARGE TEMP., PREDICTED °C	180	
<input type="checkbox"/> VOLUMETRIC EFF.,%HE/%CE(AVER)	/	/
<input type="checkbox"/> CALC. GAS ROD LOAD, kN, C **		
<input type="checkbox"/> CALC. GAS ROD LOAD, kN, T **		
<input type="checkbox"/> COMB. ROD LOAD, kN C (GAS & INERTIA)		
<input type="checkbox"/> COMB. ROD LOAD, kN T (GAS & INERTIA)		
<input type="checkbox"/> ROD REV., DEGREES MIN @ X-HD PIN ***		
<input type="checkbox"/> BkW/STAGE		
<input type="checkbox"/> TOTAL kW @ COMPRESSOR SHAFT	12	
<input type="checkbox"/> TOTAL kW INCL. V-BELT & GEAR LOSSES	13	

* SHOW OPERATION WITH THE FOLLOWING SYMBOLS:

HEAD END = HE	} PLUS	SUCTION VALVE(S) UNLOADED = S
OR		OR
CRANK END = CE		FIXED POCKET OPEN = F
	}	OR
		VARIABLE POCKET OPEN = V

** C = COMPRESSION T = TENSION *** X - HD = CROSSHEAD

MINIMUM PRESSURE REQUIRED TO OPERATE CYLINDER UNLOADING DEVICES, _____ (BARG)

CYLINDER UNLOADING MEDIUM: AIR NITROGEN OTHER _____

PRESSURE AVAILABLE FOR CYLINDER UNLOADING DEVICES, MAX/MIN _____ / _____ (BARG)

SPECIAL REMARK:

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:  شرکت پتروشیمی بوشهر	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)
--	--

Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 6 OF 20

Owner Document Number : BU 20 VD 303 ME DSH 75

● SCOPE OF BASIC SUPPLY

PURCHASER TO FILL IN () AFTER COMMODITY TO INDICATE: BY COMPR. MFR. BY PURCH. BY OTHERS

- 3 ● DRIVER (): VARIABLE SPEED SPEED RANGE NOT APPLICABLE RPM TO NOT APPLICABLE RPM
- 4 ● INDUCTION MOTOR SYNCHRONOUS MOTOR STEAM TURBINE ENGINE OTHER _____
- 5 ○ API-541 API-546 API-611 API-612
- 6 ○ OUTBOARD BEARING PROVISION FOR DRY AIR PURGE FOR OUTBOARD BEARING.
- 7 ● SLIDE BASE FOR DRIVER () SOLE PLATE FOR DRIVER ()
- 8 ● MOTOR STARTING EQUIPMENT (); DEFINE _____ MSP
- 9 ○ GEAR (): ○ BASEPLATE FOR GEAR API-613 API-677
- 10 ● COUPLING(S) (): ● LOW SPD. HI-SPD. QUILL SHAFT KEY-LESS DRV. KEY'D DRV. OTHER #1
- 11 ○ API 671
- 12 ○ V-BELT DRIVE (): ○ SHEAVES & V-BELTS () ○ STATIC CONDUCTING V-BELTS BANDED V-BELTS
- 13 ● DRIVE GUARD(S) (): ● MANUFACTURER'S STD. ● NON-SPARKING CALIF CODE API-671 APPENDIX C
- 14 ○ OTHER _____

- 15 ● PULSATION SUPPRESSORS WITH INTERNALS (): ● INITIAL INLET & FINAL DISCHARGE ● SUPPORTS ()
- 16 ○ INTERSTAGE ○ SUPPORTS ()
- 17 ○ PULSATION SUPPRESSORS WITHOUT INTRNL (): ○ INITIAL INLET & FINAL DISCHARGE ○ SUPPORTS ()
- 18 ○ INTERSTAGE ○ SUPPORTS ()
- 19 ○ SUPPRESSOR(S) TO HAVE MOISTURE REMOVAL SECTION: ○ INITIAL INLET ONLY ○ ALL INLET SUPPRESSORS
- 20 ● ACOUSTICAL SIMUL. STUDY (): DESIGN APPROACH ● 1, EMPRICAL PULSATION SUPPRESSION DEVICE SIZING
- 21 ● DIGITAL ANALOG ○ 2, ACOUSTIC SIMULATION AND PIPING RESTRAINT ANALYSIS
- 22 ○ 3, ACOUSTIC SIMULATION AND PIPING RESTRAINT ANALYSIS PLUS MECHANICAL ANALYSIS
- 23 ○ STUDY TO BE WITNESSED ○ STUDY TO CONSIDER: ALL SPECIFIED LOAD COND., INCL. ● SINGLE ACT., PLUS
- 24 ○ COMP. OPER. IN PARALLEL ○ ALTERNATE GASES
- 25 ○ WITH EXISTING COMP. AND PIPING SYSTEMS
- 26 ○ COMPRESSOR VALVE DYNAMIC RESPONSE
- 27 ● VENDOR REVIEW OF PURCHASER'S PIPING ARRANGEMENT ○ PULSATION SUPPRESSEN DEVICE LOW CYCLE FATIGUE ANALYSIS
- 28 NOTE: SEE APPENDIX N FOR INFORMATION REQUIRED FOR STUDY ○ PIPING SYSTEM FLEXIBILITY

29 PACKAGED: ○ NO ● YES () DEFINE BASIC SCOPE OF PACKAGING IN REMARKS SECTION

- 30 ● SKID ● SOLEPLT. ● BASEPLT. ● BOLTS OR STUDS FOR SOLEPLT. TO FRAME ○ RAILS ○ CHOKE BLOCKS ● SHIMS
- 31 ○ SUITABLE FOR COLUMN MOUNTING (UNDER SKID AND/OR BASEPLATE)
- 32 ● LEVELING SCREWS ○ NON-SKID DECKING ○ SUB SOLEPLATES
- 33 ● DIRECT GROUTED ● CEMENTED/MORTAR GROUT ○ EPOXY GROUT; MFG/TYPE _____ / _____
- 34 ● INTERCOOLER(S) () ○ SEPARATOR(S) () ○ AFTERCOOLER(S) ()

35 **INTERCOOLERS:**

- 36 ○ INTERSTAGE PIPE () ○ PIPING MATCHMARKED ○ SHOP FITTED ○ MACHINE MTD.
- 37 ○ CONDENSATE SEPARATION & COLLECTION FACILITY SYSTEM PER 3.8.12 ○ OFF MOUNTED
- 38 ● INLET STRAINER(S) (): ● INITIAL INLET ○ SIDESTREAM INLET ○ SPOOL PIECE FOR INLET STRAINERS
- 39 ● MANIFOLD PIPING; ○ DRAINS ○ VENTS ● RELIEF VALVES ● AIR/GAS SUPPLY ○ FLANGE FINISH
- 40 ● RELIEF VALVE(S) (): ○ INITIAL INLET ○ INTERSTAGE ● FINAL DISCHARGE ○ API-618 FLANGE FINISH
- 41 ○ RUPTURE DISC(S) () ○ THRU STUDS IN PIPING FLANGES
- 42 ○ CRANKCASE RAPID PRESSURE RELIEF DEVICE(S) () ● FLANGE FINISH PER ANSI 16.5
- 43 ○ SPECIAL PIPING REQUIREMENTS ○ SPECIAL FINISH

- 44 ○ INITIAL INLET, ○ INTERSTAGE SUCTION PIPING ARR'D FOR: INSULATION () HEAT TRACING ()
- 45 ○ FOR ATMOSPHERIC INLET AIR COMPR. ONLY: ○ INLET AIR FILTER () ○ INLET FILTER -SILENCER ()
- 46 ● PREFERRED TYPE OF CYLINDER COOLING (): ● FORCED ○ THERMOSYPHON _____ STAGE CYL(S)
- 47 ○ STATIC (STAND-PIPE) _____ STAGE CYL(S)
- 48 NOTE: MANUFACTURER SHALL RECOMMENDBEST TYPE OF COOLING AFTER FINAL ENGINEERING REVIEW OF ALLOPERATING CONDITIONS ● CYL. COOLING WATER PIPING () ○ MATCH M'RKED
- 49 ● SINGLE INLET/OUTLET MANIFOLD & VALVES ● SIGHT GL'S(S)
- 50 ● INDIVIDUAL INLET/ OUTLET PER CYL. ● VALVE(S)
- 51 ○ CLOSED SYS. WITH WATER PUMP, COOLER, SURGE TANK, & PIPING
- 52 #1: Flexible/ all-metal/spacer type/non-sparking couplings. ○ SHOP RUN ○ ARR'D FOR HEATING JACKET AS WELL AS COOLING

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:  شرکت نفت و گاز پارس 	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
---	--	---

Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 7 OF 20

Owner Document Number

- 1 **SCOPE OF BASIC SUPPLY (Con't)**
- 2 SEPARATE COOLING CONSOLE (): ONE FOR EA. UNIT ONE CMMN TO ALL UNITS DUAL PUMPS (AUX. & MAIN)
- 3 ARRANGED FOR HEATING JACKET WATER AS WELL AS COOLING
- 4 ROD PRESS. PACKING COOLING SYSTEM () SEPARATE CONSOLE COMBINE WITH JKT SYSTEM FILTERS
- 5 FRAME LUBE OIL SYSTEM (): AUX. PUMP DUAL FILTERS WITH TRANSFER VALVE SHOP RUN
- 6 CONTINUOUS FLOW IN SENSING LINE TO PRESSURE SWITCHES
- 7 SEPARATE LUBE OIL CONSOLE (): EXTENDED TO MOTOR OUTBOARD BEARING SHOP RUN
- 8 API 614 APPLIES NO YES
- 9 NOTE: PIPING BETWEEN ALL CONSOLES AND COMPRESSOR UNIT BY PURCHASER

- 10 CAPACITY CONTROL (): SEE DATA SHEET PAGE 5 FOR DETAILS INSTRUMENT & CONTROL PANEL
- 11 SEPARATE MACHINE MOUNTED PANEL SEPARATE FREE STANDING PANEL
- 12 PNEUMATIC ELECTRIC ELECTRONIC HYDRAULIC
- 13 PROGRAMMABLE CONTROLLER
- 14 INSTRUMENT & CONTROL PANEL (): ONE FOR EACH UNIT ONE COMMON TO ALL UNITS
- 15 MACHINE MOUNTED FREE STANDING (OFF UNIT)
- 16
- 17 BUFFER GAS CONTROL PANEL () = ONE FOR EACH UNIT ONE COMMON TO ALL UNITS
- 18 MACHINE MOUNTED FREE STANDING (OFF UNIT)
- 19 SEE INSTRUMENTATION DATA SHEETS FOR DETAILS OF PANEL, ADDITIONAL REMARKS, AND INSTRUMENTATION
- 20 NOTE: ALL TUBING, WIRING, & CONNECTIONS BETWEEN OFF-UNIT FREE STANDING PANELS AND COMPRESSOR UNIT BY PURCHASER

- 21
- 22
- 23 HEATERS (): FRAME LUBE OIL CYL. LUBRICATORS COOLING WATER DRIVER(S) GEAR OIL
- 24 ELECTRIC STEAM
- 25
- 26 BARRING DEVICE (): MANUAL PNEUMATIC ELECTRIC FLYWHEEL LOCKING DEVICE ()
- 27 ROD PRESSURE PACKING COOLING SYSTEM (): SEPARATE CONSOLE FILTERS
- 28 SPECIAL CORROSION PROTECTION: NO YES MFR'S STANDARD OTHER _____
- 29 HYDRAULIC TENSIONING TOOLS NO YES
- 30 MECHANICAL RUN TEST: NO YES MFG'S STANDARD OTHER _____
- 31 COMPLETE SHOP RUN TEST OF ALL MACHINE MOUNTED EQUIPMENT, PIPING & APPURT.:(S)

- 32
- 33 PAINTING: MANUFACTURER'S STANDARD SPECIAL _____
- 34 NAMEPLATES: U.S. CUSTOMARY UNITS SI UNITS
- 35 SHIPMENT: DOMESTIC EXPORT EXPORT BOXING REQUIRED ()
- 36 STANDARD 6 MONTH STORAGE PREPARATION (), PER SPEC _____
- 37 OUTDOOR STORAGE FOR OVER 12 MONTHS (), PER SPEC _____
- 38 INITIAL INSTALLATION AND OPERATING TEMP ALIGNMENT CHECK AT JOBSITE BY VENDOR REPRESENTATIVE
- 39
- 40 COMPRESSOR MANUFACTURER'S USER'S LIST FOR SIMILAR SERVICE
- 41 PERFORMANCE DATA REQUIRED PER 9.3.3: BkW VS. SUCTION PRESSURE CURVES
- 42 ROD LOAD/GAS LOAD CHARTS
- 43 VALVE FAILURE DATA CHARTED
- 44 SPEED/TORQUE CURVE DATA
- 45 BkW VS. CAPACITY PERFORMANCE CURVES OR TABLES REQUIRED FOR UNLOADING STEPS AND/OR VARIABLE
- 46 SUCTION/DISCHARGE PRESSURES

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT
---	--	---

MC:  شرکت سست اصفهان	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
---	--	---

Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 8 OF 20

UTILITY CONDITIONS									
ELECTRICAL POWER:		AC VOLTS	PHASE	HERTZ	DC VOLTS	AC VOLTS	PHASE	HERTZ	DC VOLTS
● MAIN DRIVER		400	3	50		110	1	50	24
● AUXILIARY MOTORS		400	3	50				50	24
● HEATERS	Below 0.2 Kw : 230		1	50				50	24

INSTRUMENT AIR:		NORMAL PRESSURE		barg		MAX/MIN		/		barg	
STEAM FOR: DRIVERS						HEATERS					
INLET: PRESS	(BARG)	MAX/MIN		(BARG)	INLET: PRESS	(BARG)	MAX/MIN		(BARG)		
(NORM.) TEMP	°C	MAX/MIN		°C	(NORM.) TEMP	°C	MAX/MIN		°C		
EXH'ST: PRESS	(BARG)	MAX/MIN		(BARG)	EXH'ST: PRESS	(BARG)	MAX/MIN		(BARG)		
(NORM.) TEMP	°C	MAX/MIN		°C	(NORM.) TEMP	°C	MAX/MIN		°C		

COOLING WATER		FOR: COMPRESSOR CYLINDERS		TYPE WATER		COOLERS			
SUPPLY PRESS	(BARG)	MAX/MIN		(BARG)	SUPP.: PRESS	(BARG)	MAX/MIN		(BARG)
(NORM.) TEMP	°C	MAX/MIN		°C	(NORM.) TEMP	°C	MAX/MIN		°C
RETURN: PRESS	(BARG)	MAX/MIN		(BARG)	R'TRN: PRESS	(BARG)	MAX/MIN		(BARG)
(NORM.) TEMP	°C	MAX/MIN		°C	(NORM.) TEMP	°C	MAX/MIN		°C

24 COOLING FOR ROD PACKING:

25 TYPE FLUID _____ SUPPLY PRESS _____ (BARG) @ _____ °C RETURN _____ @ _____ °C

26 FUEL GAS: NORMAL PRESSURE _____ (BARG) MAX/MIN _____ / _____ (BARG) LHV _____ MJ/m³

27 COMPOSITION _____ (kPa)

29 REMARKS/SPECIAL REQUIREMENTS:

30 _____

31 _____

32 _____

33 _____

34 _____

35 _____

36 _____

37 _____

38 _____

39 _____

40 _____

41 _____

42 _____

43 _____

44 _____

45 _____

46 _____

47 _____


48 _____




49 _____

50 _____

51 _____

52 _____

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT
---	--	---


MC:   شرکت مهندسی و پیمانکاری سازمان پتروشیمی	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	 Contract No : 52-98/445														
	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Project</th> <th>Area</th> <th>Phase</th> <th>Unit</th> <th>Dis.</th> <th>Doc.</th> <th>Seq.</th> </tr> <tr> <td style="text-align: center;">BU</td> <td style="text-align: center;">20</td> <td style="text-align: center;">VD</td> <td style="text-align: center;">303</td> <td style="text-align: center;">ME</td> <td style="text-align: center;">DSH</td> <td style="text-align: center;">75</td> </tr> </table>	Project	Area	Phase	Unit	Dis.	Doc.	Seq.	BU	20	VD	303	ME	DSH	75	
Project	Area	Phase	Unit	Dis.	Doc.	Seq.										
BU	20	VD	303	ME	DSH	75										

Owner Document Number	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 9 OF 20
------------------------------	-----------	-----------	-----------	------------	-----------	------------	-----------	-----------------	----------------------

1	<input type="checkbox"/> CYLINDER DATA AT FULL LOAD CONDITION									
2	SERVICE/ITEM NO.	Air								
3	STAGE	1								
4	INLET PRESSURE, (BARA)	8,0								
5	DISCHARGE PRESSURE, (BARA) } @ CYLINDER FLANGES	21,0								
6	CYLINDERS PER STAGE	2								
7	SINGLE OR DOUBLE ACTING (SA OR DA)	SA								
8	BORE, mm	170								
9	STROKE, mm									
10	RPM: RATED / MAX ALLOW	400/690								
11	PISTON SPEED, m/s: RATED / MAX ALLOW									
12	CYLINDER LINER, YES/NO									
13	LINER NOMINAL THICKNESS, mm									
14	PISTON DISPLACEMENT, m ³ /h									
15	CYLINDER DESIGN CLEARANCE, % AVERAGE									
16	VOLUMETRIC EFFICIENCY, % AVERAGE									
17	VALVES, INLET/DISCHARGE, QTY PER CYL.			/	/	/	/			
18	TYPE OF VALVES									
19	VALVE LIFT, INLET/DISCHARGE, mm	/	/	/	/	/	/			
20	VALVE VELOCITY, API 4TH EDITION, m/s									
21	SUCTION VALVE(S)									
22	DISCHARGE VALVE(S)									
23	ROD DIAMETER, (mm)									
24	MAX ALLOW. COMBINED ROD LOADING, kN, C *									
25	MAX ALLOW. COMBINED ROD LOADING, kN, T *									
26	CALCULATED GAS ROD LOAD, kN, C *									
27	CALCULATED GAS ROD LOAD, kN, T *									
28	COMBINED ROD LOAD (GAS + INERTIA), kN, C *									
29	COMBINED ROD LOAD (GAS + INERTIA), kN, T *									
30	ROD REV., DEGREES MIN @ X-HD PIN**									
31	RECIP WT. (PISTON, ROD, X-HD & NUTS), kg**									
32	MAX ALLOW. WORKING PRESSURE, (BARG)									
33	MAX ALLOW. WORKING TEMPERATURE, °C									
34	HYDROSTATIC TEST PRESSURE, (BARG)									
35	HELIUM TEST PRESSURE, (BARG)									
36	INLET FLANGE SIZE/RATING at CYLINDER	/	/	/	/	/	/			
37	FACING at CYLINDER									
38	DISCHARGE FLANGE SIZE/RATING at CYLINDER	/	/	/	/	/	/			
39	FACING at CYLINDER									
40	DISCHARGE RELIEF VALVE SETTING DATA AT INLET PRESSURES GIVEN ABOVE:									
41	RECOMMENDED SETTING, (BARG)									
42	GAS ROD LOAD, kN, C *									
43	GAS ROD LOAD, kN, T *									
44	COMBINED ROD LOAD, kN, C *									
45	COMBINED ROD LOAD, kN, T *									
46	ROD REVERSAL, *MIN @ X-HD PIN**									
47	NOTE: CALCULATED AT INLET PRESSURES									
48	GIVEN ABOVE & RECOMMENDED SETTING.									
49	<input type="checkbox"/> SETTLE-OUT GAS PRESSURE									
50	(DATA REQUIRED FOR STARTING)									
51	* C = COMPRESSION * T = TENSION **X-HD = CROSSHEAD									
52	NOTES/REMARKS:									
53										



**BUSHEHR PETROCHEMICAL COMPANY
MEG PLANT**

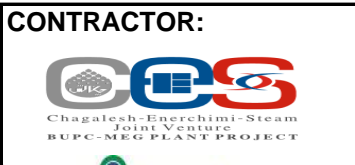

**MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR
COMPRESSOR (20-C-7080)**



Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 10 OF 20

Owner Document Number : CONSTRUCTION FEATURES

1	SERVICE ITEM NO.	_____	_____	_____	_____	_____	_____
2	STAGE	_____	_____	_____	_____	_____	_____
3	CYLINDER SIZE (BORE DIA), mm	_____	_____	_____	_____	_____	_____
4	ROD RUN-OUT: NORMAL COLD VERTICAL (per appendix C)	_____	_____	_____	_____	_____	_____

MATERIALS OF CONSTRUCTION

7	CYLINDER(S)	_____
8	CYLINDER LINER(S)	_____
9	PISTON(S)	_____
10	PISTON RINGS	_____
11	WEAR BANDS <input type="checkbox"/> REQUIRED	_____
12	PISTON ROD(S): MATERIAL/YIELD, N/mm ²	_____
13	THREAD ROOT STRESS @ MACRL * @ X-HD END	_____
14	PISTON ROD HARDNESS, BASE MATERIAL, Rc	_____
15	PISTON ROD COATING <input type="checkbox"/> REQUIRED	_____
16	COATING HARDNESS, Rc	_____
17	VALVE SEATS / SEAT PLATE	_____
18	VALVE SEAT MIN HARDNESS, Rc	_____
19	VALVE GUARDS (STOPS)	_____
20	VALVE DISCS	_____
21	VALVE SPRINGS	_____
22	ROD PRESSURE PACKING RINGS	_____
23	ROD PRESSURE PACKING CASE	_____
24	ROD PRESSURE PACKING SPRINGS	_____
25	SEAL / BUFFER PACKING, DISTANCE PIECE	_____
26	SEAL / BUFFER PACKING, INTERMEDIATE	_____
27	WIPER PACKING RINGS	_____
28	MAIN JOURNAL BEARINGS, CRANKSHAFT	_____
29	CONNECTING ROD BEARING, CRANKPIN	_____
30	CONNECTING ROD BUSHING, X-HD END	_____
31	CROSSHEAD (X-HD) PIN BUSHING	_____
32	CROSSHEAD PIN	_____
33	CROSSHEAD	_____
34	CROSSHEAD SHOES	_____
35	CYLINDER INDICATOR VALVES (X)	_____
36	INDICATOR CONNECTIONS ABOVE 5000 PSI	_____
37	FLUOROCARBON SPRAYED CYLINDER (X)	_____
38	INSTRUMENTATION IN (X) COLD SIDE	_____
39	CONTACT W/PROCESS GAS (X) HOT SIDE	_____

* MAXIMUM ALLOWABLE COMBINED ROD LOAD USE (X) IN APPROPRIATE COLUMN WHERE APPLICABLE

42	<input checked="" type="checkbox"/> COMPRESSOR CYLINDER ROD PACKING
43	<input checked="" type="checkbox"/> FULL FLOATING PACKING
44	<input checked="" type="checkbox"/> VENTED TO: <input type="checkbox"/> FLARE @ _____ <input checked="" type="checkbox"/> ATM
45	<input type="checkbox"/> SUCTION PRESSURE @ _____ (BARG)
46	<input type="checkbox"/> FORCED LUBRICATED <input checked="" type="checkbox"/> NON-LUBE <input type="checkbox"/> TFE
47	<input checked="" type="checkbox"/> WATER COOLED, _____ STAGE(S), _____ m ³ /h REQ'D
48	<input checked="" type="checkbox"/> OIL COOLED, _____ STAGE(S), _____ m ³ /h REQ'D
49	<input type="checkbox"/> WATER FILTER PROV.FUTURE WATER/OIL COOLING
50	<input type="checkbox"/> VENT/BUFFER GAS SEAL PACKING ARR. (Ref: Appndx I FIG I-1)
51	<input type="checkbox"/> CONSTANT OR <input type="checkbox"/> VARIABLE DISPOSAL SYSTEM
52	<input type="checkbox"/> BUFFER GAS PRESSURE, _____ (BARG)
53	<input type="checkbox"/> SPLASH GUARDS FOR WIPER PACKING

DISTANCE PIECE(S):	<input type="checkbox"/> TYPE A <input checked="" type="checkbox"/> TYPE B <input type="checkbox"/> TYPE C <input type="checkbox"/> TYPE D
COVERS:	<input checked="" type="checkbox"/> SOLID METAL <input type="checkbox"/> SCREEN <input type="checkbox"/> LOUVERED
CYLINDER COMPARTMENT:	<input checked="" type="checkbox"/> VENTED TO _____ (BARG)
(Outboard Distance Piece)	<input type="checkbox"/> PURGED AT _____ (BARG)
	<input type="checkbox"/> PRESSURIZED TO _____ (BARG)
	<input type="checkbox"/> WITH RELIEF VALVE
FRAME COMPARTMENT:	<input type="checkbox"/> VENTED TO _____ (BARG)
(Inboard Distance Piece)	<input type="checkbox"/> PURGED AT _____ (BARG)
	<input type="checkbox"/> PRESSURIZED TO _____ (BARG)
	<input type="checkbox"/> WITH RELIEF VALVE
<input type="checkbox"/> DISTANCE PIECE MAWP	_____ (BARG)

Ref: Appendix G, Fig. G-3

OWNER:  شرکت پترو شیمیایی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:  شرکت مهندسی و پیمانکاری نپک	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)
---	--

Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 11 OF 20

Owner Document Number : BU 20 VD 303 ME DSH 75 Rev : 00 Page: 11 OF 20

<input type="checkbox"/> CONSTRUCTION FEATURES (CONTINUED) <input type="checkbox"/> FABRICATED CYLINDER, HEADS, & CONNECTION SKETCHES FOR DESIGN REVIEW BY PURCHASER.	<input type="checkbox"/> BUFFER GAS PACKING ARR. Ref: Appendix I <input type="checkbox"/> OIL WIPER PACKING PURGE Figures I-1, I-2 & I-3 <input type="checkbox"/> INTERMEDIATE PARTITION PURGE INERT BUFFER PURGE GAS: ● N ₂ ○ OTHER _____ <input checked="" type="checkbox"/> VENT, DRAIN, PURGE PIPING BY MFG'R ○ NO ● YES
---	--

<input checked="" type="checkbox"/> COUPLING(S) ○ LOW-SPEED ○ HI-SPEED Between Compressor & Driver or Gear Between Driver & Gear ◆ BY MANUFACTURER _____ ◆ MODEL _____ ◆ TYPE _____ API-671 APPLIES ● YES ○ NO	<input checked="" type="checkbox"/> V-BELT DRIVE DRIVEN SHEAVE DRIVE SHEAVE (Compressor Shaft) (Driver Shaft) RPM (EXPECTED) 400 1475 PITCH DIA. (Inches) _____ ◆ QTY & GROOVE X-SEC. 4 _____ POWER TRANSMIT'D 13 15 Incl. Belt Losses DRIVER NAMEPLATE HP RATING _____ ◆ CENTER DISTANCE (INCHES) _____ ◆ QTY, TYPE, X-SEC., & LENGTH BELTS _____ ◆ BELT SERVICE FACTOR (RELATIVE TO DRIVER NAMEPLATE HP RATING) _____
--	---



<input type="checkbox"/> INSPECTION AND SHOP TESTS	
	REQ'D WITN. OBSER.
*SHOP INSPECTION	● ○ ○
ACTUAL RUNNING CLEARANCES AND RECORDS	○ ○ ○
MFG STANDARD SHOP TESTS	● ○ ○
CYLINDER HYDROSTATIC TEST	○ ○ ○
CYLINDER PNEUMATIC TEST	○ ○ ○
CYLINDER HELIUM LEAK TEST	○ ○ ○
CYL. JACKET WATER HYDRO TEST	○ ○ ○
*MECHANICAL RUN TEST (4 HR)	● ○ ●
BAR-OVER TO CHECK ROD RUNOUT	○ ○ ○
*LUBE OIL CONSOLE RUN/TEST (4 HR)	● ○ ●
*COOLING H ₂ O CONSOLE RUN/TEST	● ○ ●
RADIOGRAPHY BUTT WELDS	○ ○ ○
○ GAS ○ OIL ○ FAB CYLS.	○ ○ ○
MAG PARTICLE/LIQUID PENETRANT OF WELDS	○ ○ ○
SPECIFY ADDITIONAL REQUIREMENTS (4.2.1.3)	○ ○ ○
QC OF INACCESSIBLE WELDS (2.14.5.2.4)	○ ○ ○
SHOP FIT-UP OF PULSATION SUPPL. DEVICES & ALL ASSOCIATED GAS PIPING	○ ○ ○
*CLEANLINESS OF EQUIP., PIPING, & APPURTENANCES	● ○ ○
*HARDNESS OF PARTS, WELDS & HEAT AFFECTED ZONES	○ ○ ○
*NOTIFICATION TO PURCHASER OF ANY REPAIRS TO MAJOR COMPONENTS	● ● ●
SOUND LEVEL TEST	● ○ ○
DISMANTLING INSPECTION	○ ○ ○
*SPECIFIC REQUIREMENTS TO BE DEFINED, FOR EXAMPLE, DISMANTLING, AUX EQUIPMENT OPERATIONAL & RUN TESTS.	○ ○ ○

<input checked="" type="checkbox"/> CYLINDER LUBRICATION <input checked="" type="checkbox"/> NON-LUBE _____ STAGE(S)/SERVICE <input type="checkbox"/> LUBRICATED _____ STAGE(S)/SERVICE TYPE OF LUBE OIL: ○ SYNTHETIC _____ ○ HYDROCARBON _____ LUBRICATOR □ COMP. CRANKSHAFT, DIRECT DRIVE BY: □ CHAIN, FROM CRANKSHAFT <input checked="" type="checkbox"/> ELECTRIC MOTOR <input checked="" type="checkbox"/> OTHER _____ ◆ LUBRICATOR MFR _____ ◆ MODEL _____ TYPE LUBRICATOR: ○ SINGLE PLUNGER PER POINT (2.13) ○ DIVIDER BLOCKS _____ ◆ COMPARTM'T, TOTAL QTY. _____ ◆ PLUNGERS (PUMPS), TOTAL QTY. _____ ◆ SPARE PLUNGERS, QTY. _____ ◆ SPARE COMPARTM'T W/OUT PLUNGERS _____ ○ HEATERS: ○ ELECTRIC W/THERM.(S) ○ STEAM	
--	--

<input type="checkbox"/> ESTIMATED WEIGHTS AND NOMINAL DIMENSIONS <input type="checkbox"/> TOTAL COMPR. WT, LESS DRIVER & GEAR _____ kg ◆ WT, OF COMPLETE UNIT, (LESS CONSOLES) 3000 kg ◆ MAXIMUM ERECTION WEIGHT _____ kg ◆ MAXIMUM MAINTENANCE WEIGHT 211 kg ◆ DRIVER WEIGHT/GEAR WEIGHT _____ / 211 kg ◆ LUBE OIL/COOLING H ₂ O CONS. _____ / _____ kg ◆ FREE STANDING PANEL _____ SPACE REQUIREMENTS-mm: LENGTH WIDTH HEIGHT ◆ COMPLETE UNIT _____ ◆ LUBE OIL CONSOLE _____ ◆ COOLING H ₂ O CONSOLE _____ ◆ FREE STANDING PANEL _____ <input type="checkbox"/> PISTON ROD REMOVAL DIST. _____ OTHER EQUIPMENT SHIPPED LOOSE (DEFINE) ◆ PULSATION SUPP., WEIGHT 70 kg ◆ PIPING 50 kg ◆ INTERSTAGE EQUIPMENT _____ kg	
---	--

APPENDIX K COMPLIANCE: ○ VENDOR ○ PURCHASER
 NOTE: - INSPECTION AND TESTING SHALL BE AS PER SCOPE OF INSPECTION SHEETS ATTACHED TO MATERIAL REQUISITION.

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:  شرکت مهندسی و پیمانکاری ندپتک	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)							
	Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445

Owner Document Number : BU 20 VD 303 ME DSH 75 Rev : 00 Page: 12 OF 20

UTILITY CONSUMPTION

ELECTRIC MOTORS

		NAMEPLATE HP (kW)	LOCKED ROTOR AMPS	FULL LOAD AMPS	
9	◆ MAIN DRIVER	15	239	28,5	
10	◇ MAIN LUBE OIL PUMP				
11	◇ AUX LUBE OIL PUMP				
12	◇ MAIN COOLING WATER PUMP				
13	◇ AUX COOLING WATER PUMP				
14	◇ ROD PACKING COOLING PUMP				
15	◇ CYLINDER LUBRICATOR				
16					
17					
18					

ELECTRIC HEATERS

		WATTS	VOLTS	HERTZ	
22	◆ FRAME OIL HEATER(S)	TBC	110	50	
23	◇ COOLING WATER HEATER(S)				
24	◇ CYL. LUBRICATOR HEATER(S)				
25	◇ MAIN DRIVER SPACE HEATER(S)				
26					
27					

STEAM-NOT APPLICABLE

		FLOW	PRESSURE	TEMPERATURE	BACK PRESSURE
31	◇ MAIN DRIVER	kg/h @	(BARG) (kPa)	°CTT TO	(BARG) (kPa)
32	◇ FRAME OIL HEATER(S)	kg/h @	(BARG) (kPa)	°CTT TO	(BARG) (kPa)
33	◇ CYL. LUB. HEATER(S)	kg/h @	(BARG) (kPa)	°CTT TO	(BARG) (kPa)
34		kg/h @	(BARG) (kPa)	°CTT TO	(BARG) (kPa)
35		kg/h @	(BARG) (kPa)	°CTT TO	(BARG) (kPa)

COOLING WATER REQUIREMENTS-(NOTE 9)

		FLOW m³/h	INLET TEMP °C	OUTLET TEMP °C	INLET PRESS (BARG)	OUTLET PRESS (BARG)	MAX PRESS (BARG)
40	□ CYLINDER JACKETS						
41	◆ INTERCOOLER(S)	1,7	35	45	4,5	3,5	6
42	◇ AFTERCOOLER						
43	◇ FRAME LUBE OIL COOLER						
44	◇ ROD PRESSURE PACKING*						
45	◆ CYLINDER COOLANT CONSOLE	0,90	35	45	4,5	3,5	6
46							
47							
48	◆ TOTAL QUANTITY, m³/h	2,6					

49
50
51

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT
---	--	---

MC:  شرکت مهندسی و پیمانکاری اندیشه و عمران	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
--	--	---

Owner Document Number :	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 13 OF 20
--------------------------------	-----------	-----------	-----------	------------	-----------	------------	-----------	-----------------	-----------------------

1	<input type="checkbox"/> FRAME LUBE OIL SYSTEM								
2	<input checked="" type="checkbox"/> BASIC LUBE OIL SYSTEM FOR FRAME:		<input checked="" type="checkbox"/> SPLASH (TBA)		<input checked="" type="checkbox"/> PRESSURE (FORCED)		<input checked="" type="checkbox"/> HEATERS REQUIRED:		
3	<input type="checkbox"/> REF: TYPE MAIN BEARINGS:		<input type="checkbox"/> TAPERD ROLLER		<input type="checkbox"/> PRECISION SLEEVE		<input checked="" type="checkbox"/> ELEC. W/THERMOSTAT(S) <input type="checkbox"/> STEAM		
4	<input checked="" type="checkbox"/> PRESSURE SYSTEM:		<input checked="" type="checkbox"/> MAIN OIL PUMP DRIVEN BY:		<input checked="" type="checkbox"/> COMP. CRANKSHAFT		<input type="checkbox"/> ELEC. MOTOR <input type="checkbox"/> OTHER _____		
5					<input type="checkbox"/> PSV FOR MAIN PUMP EXTERNAL TO CRANKCASE				
6			<input type="checkbox"/> AUX OIL PUMP DRIVEN BY:		<input type="checkbox"/> ELEC. MOTOR		<input type="checkbox"/> OTHER _____		
7			<input type="checkbox"/> HAND OPERATED PRE-LUBE PUMP FOR STARTING		<input checked="" type="checkbox"/> OPERATIONAL TEST & 4 HOUR MECH RUN TEST				
8			<input type="checkbox"/> API-614 LUBE SYSTEM: <input type="checkbox"/> NO <input type="checkbox"/> YES		<input type="checkbox"/> CHECK VALVE ON MAIN PUMP				
9			<input type="checkbox"/> CONTINUOUS FLOW THROUGH OIL (7.7.2.5)						
10	<input type="checkbox"/> SEP. CONSOLE FOR PRESS. LUBE SYS:		<input type="checkbox"/> ONE CONSOLE FOR EA. COMP.		<input type="checkbox"/> ONE CONSOLE FOR _____ COMPRESSORS				
11			<input type="checkbox"/> CONSOLE TO BE OF DECK PLATE TYPE CONSTRUCTION SUITABLE FOR MULTI-POINT SUPPORT AND GROUTING WITH GROUT & VENT HOLES.						
12									
13	<input type="checkbox"/> ELECTRICAL CLASSIFICATION : ZONE 2		GROUP IIB		CLASS _____		T3		<input type="checkbox"/> NON-HAZARDOUS

<input checked="" type="checkbox"/> BASIC SYS. REQ'MTS (NORM. OIL FLOWS & VOLUMES)						
<input checked="" type="checkbox"/> LUBE OIL	FLOW m³/h	PRESSURE (BARG)	VISCOSITY cst @ 40°C	VISCOSITY cst @ 100°C	SUMP VOLUME m³	
<input type="checkbox"/> COMPRESSOR FRAME	_____	_____	_____	_____	_____	
<input type="checkbox"/> DRIVER	_____	_____	_____	_____	_____	
<input type="checkbox"/> GEAR	_____	_____	_____	_____	_____	
<input type="checkbox"/> SYSTEM PRESSURES:	<input type="checkbox"/> DESIGN _____ (BARG)	<input type="checkbox"/> HYDROTEST _____ (BARG)				
	<input type="checkbox"/> PRESSURE CONTROL VALVE SETTING _____ VTS (BARG)	<input type="checkbox"/> PUMP RELIEF VALVE(S) SET _____ (BARG)				

22	<input checked="" type="checkbox"/> PIPING MATERIALS:		
23	CARBON STEEL	STAINLESS STEEL WITH SS FLANGES	STAINLESS STEEL WITH CARBON STEEL FLANGES
24	<input checked="" type="checkbox"/> UPSTREAM OF PUMPS & FILTERS	<input type="checkbox"/>	<input type="checkbox"/>
25	<input checked="" type="checkbox"/> DOWNSTREAM OF FILTERS	<input type="checkbox"/>	<input type="checkbox"/>
26	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
27	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>


28	<input type="checkbox"/> PUMPS	RATED FLOW	PRESSURE (BARG)	COLD START REQ'D KW	DRIVER KW	SPEED RPM	COUPLING REQ'D	MECH. SEAL REQ'D
29		_____	_____	_____	_____	_____	<input type="checkbox"/>	<input type="checkbox"/>
30	MAIN	NA	2.0	NA	SHAFT DRIVEN	NA	<input type="checkbox"/>	<input type="checkbox"/>
31	AUXILIARY	_____	_____	_____	_____	_____	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
32	<input checked="" type="checkbox"/> PUMP CASING MATERIAL	MAIN PUMP		STEEL		AUX PUMP		STEEL
33	<input type="checkbox"/> GUARD(S) REQ. FOR COUPLING(S):	<input type="checkbox"/> MAIN PUMP	<input type="checkbox"/> AUX PUMP	<input type="checkbox"/> GUARD TYPE OR CODE		<input type="checkbox"/> NON-SPARKING		
34	<input type="checkbox"/> AUXILIARY PUMP CONTROL:	<input type="checkbox"/> MANUAL	<input type="checkbox"/> AUTOMATIC	<input type="checkbox"/> ON-OFF-AUTO SEL. SWITCH:		<input type="checkbox"/> BY PURCH. <input checked="" type="checkbox"/> BY MFR.		
35				<input type="checkbox"/> WIRING TO TERMINAL BOX:		<input type="checkbox"/> BY PURCH. <input checked="" type="checkbox"/> BY MFR.		
36				<input type="checkbox"/> SWITCHES		<input type="checkbox"/> RTD'S/THERMOCOUPLES		

37	<input checked="" type="checkbox"/> COOLERS:							
38	<input checked="" type="checkbox"/> SHELL & TUBE	<input checked="" type="checkbox"/> SINGLE	<input type="checkbox"/> DUAL W/TRANSFER VALVE	<input type="checkbox"/> MFG'S STD.	<input checked="" type="checkbox"/> TEMA C	<input type="checkbox"/> TEMA R		
39	<input type="checkbox"/> REMOVABLE BUNDLE	<input checked="" type="checkbox"/> WATER COOLED	<input type="checkbox"/> AIR COOLED W/AUTO TEMP CONTROL					
40	<input type="checkbox"/> W/BYPASS & TEMP CONTROL VALVE:	<input type="checkbox"/> MANUAL	<input type="checkbox"/> AUTO	<input type="checkbox"/> SEE SEPARATE HEAT EXCHANGER DATA SHEET				

41	<input type="checkbox"/> FILTER(S)							
42	<input type="checkbox"/> SINGLE	<input checked="" type="checkbox"/> DUAL W/TRANSFER VALVE	<input checked="" type="checkbox"/> ASME CODE DESIGN	<input type="checkbox"/> ASME CODE STAMPED				
43	<input type="checkbox"/> DESIGN PRESSURE, _____ (BARG)	<input type="checkbox"/> Δ P CLEAN, _____ (BARG)	<input type="checkbox"/> Δ P COLLAPSE, _____ (BARG)					
44	<input type="checkbox"/> MICRON RATING, _____	<input type="checkbox"/> CARTRIDGE MATERIAL, _____	<input type="checkbox"/> CARTRIDGE P/N _____					
45	<input type="checkbox"/> BONNET MATERIAL, _____	<input type="checkbox"/> CASING MATERIAL, _____	<input checked="" type="checkbox"/> FURN.SPARE CARTR.,QTY _____					

45	<input type="checkbox"/> SYS. COMPONENT SUPP.	MANUFACTURER	MODEL	MANUFACTURER	MODEL
46	<input checked="" type="checkbox"/> MAIN PUMP	Airpack	_____	<input type="checkbox"/> OIL COOLER(S)	_____
47	<input type="checkbox"/> AUXILIARY PUMP	_____	_____	<input type="checkbox"/> TRANSFER VALVE(S)	_____
48	<input checked="" type="checkbox"/> MECHANICAL SEALS	Airpack	_____	<input type="checkbox"/> PUMP COUPLING(S)	_____
49	<input checked="" type="checkbox"/> ELECTRIC MOTORS	WEG	_____	<input checked="" type="checkbox"/> SUCTION STRAINER(S)	TBC
50	<input type="checkbox"/> STEAM TURBINES	_____	_____	<input checked="" type="checkbox"/> CHECK VALVE(S)	TBC
51	<input checked="" type="checkbox"/> OIL FILTER(S)	Airpack	_____	<input type="checkbox"/>	_____


OWNER:



شرکت پتروشیمی بوشهر
BUPC

**BUSHEHR PETROCHEMICAL COMPANY
MEG PLANT**

CONTRACTOR:



Chagalesh-Enerchimi-Steam
Joint Venture
BUPC-MEG PLANT PROJECT

MC:




شرکت مهندسی و پیمانکاری
NDV EC
SSTI

**MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT
AIR COMPRESSOR (20-C-7080)**



Project	Area	Phase	Unit	Dis.	Doc.	Seq.	Contract No : 52-98/445
BU	20	VD	303	ME	DSH	75	Rev : 00 Page: 14 OF 20

Owner Document Number : BU 20 VD 303 ME DSH 75 Rev : 00 Page: 14 OF 20

COOLING WATER SYSTEM

BASIC COOLING SYS. FOR: COMPRESSOR CYL.(S) INTERCOOLER(S) AFTERCOOLER OIL COOLER(S)

HEATERS REQ.'D FOR PRE-HEATING: ELEC.,W/ THERMOSTAT(S) STEAM

PRESSURE FORCED CIRCULATING SYS.: OPEN, PIPING BY: PURCH MFR CLOSED, PIPING BY MFR.

 MAIN WATER PUMP DRIVEN BY: ELEC. MOTOR STEAM TURBINE OTHER

 AUX WATER PUMP DRIVEN BY: ELEC. MOTOR STEAM TURBINE OTHER

SEP. CONSOLE FOR COOLING WATER SYS.: ONE CONSOLE FOR EA. COMP. ONE CONSOLE FOR _____ COMP'RS

CONSOLE TO BE OF DECK PLATE TYPE CONSTRUCTION SUITABLE FOR MULTI-POINT SUPPORT AND GROUTING WITH GROUT & VENT HOLES.

ELECTRICAL CLASSIFICATION ZONE 2 IIB T3 NON-HAZARDOUS

BASIC SYS. REQ'MTS (NORM. COOLING WATER FLOW DATA) COOL'G WATER TO BE _____ % ETHYL'NE GLYC'L SITE

	FORCED COOL'G	THERMO SYPHON	STAND PIPE	FLOW m³/h	PRESSURE (BARG)	INLET TEMP °C	OUTLET TEMP °C	FLOW INDTR
CYLINDER(S), _____ STAGE	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	0,9	4,5	35	45	<input checked="" type="checkbox"/>
CYLINDER(S), _____ STAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____	_____	_____	_____	<input type="checkbox"/>
CYLINDER(S), _____ STAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____	_____	_____	_____	<input type="checkbox"/>
CYLINDER(S), _____ STAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____	_____	_____	_____	<input type="checkbox"/>
CYLINDER(S), _____ STAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____	_____	_____	_____	<input type="checkbox"/>
CYLINDER(S), _____ STAGE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____	_____	_____	_____	<input type="checkbox"/>
PISTON ROD PACK'G TOTAL	<input type="checkbox"/>	_____	_____	_____	_____	_____	_____	<input type="checkbox"/>
INTERCOOLER(S) TOTAL	<input type="checkbox"/>	_____	_____	_____	_____	_____	_____	<input type="checkbox"/>
AFTERCOOLER	<input type="checkbox"/>	_____	_____	_____	_____	_____	_____	<input type="checkbox"/>
OIL COOLER(S)	<input type="checkbox"/>	_____	_____	_____	_____	_____	_____	<input type="checkbox"/>
JACKET COOLER	<input type="checkbox"/>	_____	_____	_____	_____	_____	_____	<input type="checkbox"/>
TOTAL FLOW	_____	_____	_____	_____	_____	_____	_____	_____

SYS. PRESSURES: DESIGN, _____ (BARG) (kPa) HYDROTEST, _____ (BARG) (kPa) RELIEF VALVE(S), SETTING _____ PSIG

WATER RESERVOIR: SIZE, _____ mm DIA X _____ mm HT. CAPACITY _____ m³ _____ m @ Normal Operating Level

RESERVOIR MATERI.c.s INTERNAL COATING, TYPE _____

LEVEL GAUGE LEVEL SWITCH DRAIN VALVE INSPECTION & CLEAN-OUT OPENINGS

PUMPS: (Centrifugal Only) RAT'D FL'W m³/h PRESS. (BARG) REQ'D kW DRIVER kW SPEED RPM COUPLING REQ'D MECH.SEAL REQ'D

 MAIN _____ _____ _____ _____ _____ _____ _____ _____

 AUXILIARY _____ _____ _____ _____ _____ _____ _____ _____

PUMP CASING MATERIAL (Ref 6.14.2.1.5): MAIN PUMP _____ AUX PUMP _____

GUARD(S) REQ.'D FOR COUP'G(S) MAIN PUMP AUX PUMP GUARD TYPE OR CODE _____

AUX.PUMP CONTROL: MANUAL AUTO ON-OFF-AUTO SEL. SWITCH: BY PURCH. BY MANUFACTURER

WIRING TO TERMINAL BOX: BY PURCH. BY MANUFACTURER

COOLING WATER HEAT EXCH.: SHELL & TUBE SINGLE DUAL W/TRANSFER VALVE TEMA C TEMA R(API-660)

AIR COOLED EXCHANGER W/AUTO TEMP CONTROL (API-661 Data Sheets Attached)

W/BYPASS & TEM. CONTROL VALVE MANUAL AUTO LOUVERS FOR AIR EXCH.

SEE SEPARATE COOLER DATA SHEET FOR DETAILS; SPECIFY % GLYCOL ON BOTH SIDES OF SHELL & TUBE

SYS. COMPONENT SUPP.

	MANUFACTURER	MODEL	MANUFACTURER	MODEL
<input type="checkbox"/> MAIN PUMP	_____	_____	<input type="checkbox"/> TEMP CONTROL VALVE(S)	_____
<input type="checkbox"/> AUXILIARY PUMP	_____	_____	<input type="checkbox"/> TRANSFER VALVE(S)	_____
<input type="checkbox"/> MECHANICAL SEALS	_____	_____	<input type="checkbox"/> PUMP COUPLING(S)	_____
<input type="checkbox"/> ELECTRIC MOTORS	_____	_____	_____	_____
<input type="checkbox"/> STEAM TURBINES	_____	_____	_____	_____

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:  شرکت پتروشیمی بوشهر	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
--	--	---

Owner Document Number :	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 15 OF 20
--------------------------------	-----------	-----------	-----------	------------	-----------	------------	-----------	-----------------	-----------------------

PULSATION SUPPRESSION DEVICES FOR RECIPROCATING COMPRESSORS
 THESE SHEETS TO BE FILLED OUT FOR EACH SERVICE AND/OR STAGE OF COMPRESSION

3	APPLICABLE TO:	<input checked="" type="radio"/> PROPOSALS <input type="radio"/> PURCHASE <input type="radio"/> AS BUILT	
4	FOR/USER	BUSHEHR PETROCHEMICAL COMPANY (BUPC)	
5	SITE/LOCATION	ASSALUYE	AMBIENT TEMPERATURE MIN/MAX 5 / 55 °C
6	COMPRESSOR SERVICE	EMERGENCY INSTRUMENT AIR COMP	NUMBER OF COMPRESSORS 1 SET
7	COMPRESSOR MFG.	MODEL/TYPE	
8	SUPPRESSOR MFG.		
9	NOTE:	<input type="radio"/> Ind.Data Comp.'d Purch. <input type="checkbox"/> By Compr/Supp.Mfg.w/Proposal <input type="checkbox"/> By Mfg(s) after order <input checked="" type="checkbox"/> By Mfg(s)/Purchaser as Applicable	

GENERAL INFORMATION APPLICABLE TO ALL SUPPRESSORS

11	TOTAL NUMBER OF SERVICES AND/OR STAGES	2	TOTAL NUMBER OF CRANKTHROWS	1	STROKE		mm RPM
13	<input checked="" type="radio"/> ASME CODE DESIGN <input type="radio"/> GOVERNMENTAL CODES OF _____	CODE REGULATIONS APPLY					
14	<input type="radio"/> OTHER APPLICABLE PRESSURE VESSEL SPEC. OR CODE						
15	<input type="radio"/> LUBE SERVICE <input checked="" type="radio"/> NON-LUBE SERV. <input type="radio"/> NO OIL ALLOWED INTERNALLY DRY TYPE INTER.CORR.COATING <input type="radio"/> YES <input type="radio"/> NO						
16	<input type="radio"/> RADIOGRAPHY (X-RAY OF WELDS): <input checked="" type="radio"/> NONE <input type="radio"/> SPOT <input type="radio"/> 100% <input type="radio"/> IMPACT TEST <input type="radio"/> SPECIAL WELDING REQUIREMENTS						
17	<input type="radio"/> SHOP INSPECTION <input type="radio"/> WITNESS HYDROTEST <input checked="" type="radio"/> OUTDOOR STORAGE OVER 12 MONTHS <input type="radio"/> SPECIAL PAINT SPEC: BU-20-D-000-PI-SPC-409						
18	<input type="radio"/> WITNESSED <input type="radio"/> OBSERVED						


CYLINDER, GAS, OPERATING, AND SUPPRESSOR DESIGN DATA

21		SERVICE	EMERGENCY INSTRUMENT AIR COMP	STAGE NO.	2
22	<input type="checkbox"/> COMPRESSOR MANUFACTURER'S RATED CAPACITY	LBS/HR	SCFM	MMSCFD	
23	<input type="checkbox"/> LINE SIDE OPERATING PRESSURE	INLET, _____ (BARA)	DISCHARGE, _____ (BARA)		
24	<input type="checkbox"/> OPERATING TEMP. WITHIN SUPPRESSORS	INLET, _____ °C	DISCHARGE, _____ °C		
25	<input type="radio"/> ALLOWABLE PRESSURE DROP THROUGH SUPPRESSORS	Δ P _____ (BAR) / _____ %	Δ P _____ (BAR) / _____ %		
26		INLET SUPPRESSOR	DISCHARGE SUPPRESSOR		
27	<input checked="" type="radio"/> SUPPRESSOR TAG NUMBER	20-DC-7080-1	20-DC-7080-2		
28	<input checked="" type="radio"/> COMBINATION INLET SUPP SEPARATOR/INTERNALS	<input type="radio"/> YES <input checked="" type="radio"/> NO	<input type="radio"/> YES <input checked="" type="radio"/> NO	<input type="radio"/> YES <input checked="" type="radio"/> NO	<input type="radio"/> YES <input checked="" type="radio"/> NO
29	<input checked="" type="checkbox"/> NO. (QTY) OF INLET & DISCH. SUPP. PER STAGE	1	1		
30	<input type="radio"/> ALLOWABLE PEAK-PEAK PULSE @ LINE SIDE NOZZLE	(BAR) _____ / _____ %	(BAR) _____ / _____ %		
31	<input type="radio"/> ALLOWABLE PEAK-PEAK PULSE @ CYL FLANGE NOZZLE	(BAR) _____ / _____ %	(BAR) _____ / _____ %		
32	<input checked="" type="radio"/> DESIGN FOR FULL VACUUM CAPABILITY	<input type="radio"/> YES <input checked="" type="radio"/> NO	<input type="radio"/> YES <input checked="" type="radio"/> NO		
33	<input checked="" type="radio"/> MIN. REQ'D WORKING PRESSURE & TEMPERATURE	NOTE: AFTER DESIGN, THE ACTUAL MAWP & TEMP ARE TO BE DETERMINED BASED ON THE WEAKEST COMPONENT AND STAMPED ON THE VESSEL, THE ACTUAL MAWP IS TO BE SHOWN ON PG. 14 LINE 12 AND ON THE U1A FORMS			
34		(BARA) 13,5 @ 80 °C	(BARA) 25 @ 210 °C		
35					
36					
37					
38	<input checked="" type="radio"/> INITIAL SIZING VOL. PER FORMULA OF 7.9.3.2				
39	NOTE: This is a Reference	0,3 m ³	0,3 m ³		
40					
41	<input checked="" type="checkbox"/> AS BUILT VOLUME (m ³)				

#2 : PULSATION DAMPING FOR INLET AND OUTLET OF EACH CYLINDER, BY VOLUME BOTTLES.



**BUSHEHR PETROCHEMICAL COMPANY
MEG PLANT**

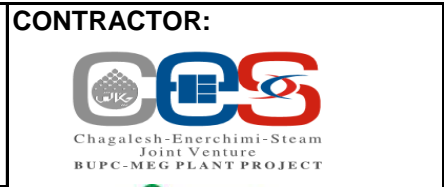

**MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT
AIR COMPRESSOR (20-C-7080)**

Project	Area	Phase	Unit	Dis.	Doc.	Seq.
BU	20	VD	303	ME	DSH	75

Contract No : 52-98/445

Owner Document Number :

BU 20 VD 303 ME DSH 75

Rev : 00 Page: 16 OF 20

1 **PULSATION SUPPRESSION DEVICES FOR RECIPROCATING COMPRESSORS (CONT'D)** SERVICE _____
 2 THESE SHEETS TO BE FILLED OUT FOR EACH SERVICE AND/OR STAGE OF COMPRESSION STAGE NO. _____

- CONSTRUCTION REQUIREMENTS & DATA**
- SUPPRESSOR TAG NUMBER
 - BASIC MATERIAL REQUIRED, CS, SS, ETC.
 - ◇ ACTUAL MATERIAL DESIGNATION SHELL/HEAD
 - SPECIAL HARDNESS LIMITATIONS, Rc ○ YES ● NO
 - CORROSION ALLOWANCE., mm ● REQUIRED
 - ◆ WALL THICKNESS, mm SHELL/HEAD
 - NOM. SHELL DIA X OVERALL LGTH. (mm/m³)
 - PIPE OR ROLLED PLATE CONSTRUCTION
 - ◆ ACT. MAX ALLOW. WORKING PRESS. AND TEMPERATURE
 - MINIMUM DESIGN METAL TEMP (2.14.8)
 - INLET SUPPRESS. TO BE SAME MAWP AS DISCH'RG SUPPRESS.
 - ◇ MAX EXPECTED PRESSURE DROP(Δ P, %) LINE PRESS
 - ◇ WEIGHT (EACH)
 - INSUL CLIP
 - ◇ EXPECTED P-P PULSE @ LINE SIDE/CYL FLG, % LINE PRESS BASED ON FINAL SUPPRESSOR DESIGN
 - SUPPORTS, TYPE/QUANTITY

INLET SUPPRESSOR		DISCHARGE SUPPRESSOR	
Carbon Steel		Carbon Steel	
/		/	
SHELL & HEADS	WELDS	SHELL & HEADS	WELDS
1,5	mm	1,5	mm
mm/	mm	mm,	mm
mm/	mm ³	mm,	mm ³
□ PIPE	□ ROLLED PLATE	□ PIPE	□ ROLLED PLATE
(BAR)	@ °C	(BAR)	@ °C
	°C		°C
○ YES	○ NO		
Δ P (BAR) /	%	Δ P (BAR) /	%
	kg		kg
	VTS		VTS
	%/ %		%/ %

CONNECTION REQUIREMENTS & DATA

- LINE SIDE FLANGE. SIZE/RATING/FACING/TYPE
- COMP CYL FLANGE(S), QTY/SIZE/RATING/FACING/TYPE
- FLANGE FINISH, ○ PER 3.9.3.15 ○ SPECIAL (SPECIFY) >3.2 <6.4 ● PER ANSI 16.5
- INSPECTION OPENINGS REQUIRED
- SPEC. QTY. SIZE, /FLG TYPE & RATING
- ◇ * QTY. SIZE, /FLG TYPE & RATING
- VENT CONNECTIONS REQUIRED
- SPEC. QTY. SIZE, /FLG TYPE & RATING
- ◇ * QTY. SIZE, /FLG TYPE & RATING
- DRAIN CONNECTIONS REQUIRED
- SPEC. QTY. SIZE, /FLG TYPE & RATING
- ◇ * QTY. SIZE, /FLG TYPE & RATING
- PRESSURE CONNECTIONS REQUIRED
- SPEC. QTY. SIZE, /FLG TYPE & RATING
- ◇ * QTY. SIZE, /FLG TYPE & RATING
- TEMPERATURE CONNECTIONS REQUIRED
- SPEC. QTY. SIZE, /FLG TYPE & RATING
- CYL NOZZLE ○ MAIN BODY
- ◇ * QTY. SIZE, /FLG TYPE & RATING

VTS/VTS/RF/WN	VTS/VTS/RF/WN
VTS	VTS
○ YES ● NO ○ BLINDED	○ YES ● NO ○ BLINDED
○ YES ● NO	○ YES ● NO
○ YES ● NO	○ YES ● NO
○ YES ● NO	○ YES ● NO
○ YES ● NO	○ YES ● NO

OTHER DATA AND NOTES

- ◆ COMPRESSOR MFG'S SUPP. OUTLINE OR DRAWING NO.
- ◇ SUPP. MFG'S OUTLINE OR DRAWING NO.

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:   شرکت سست، انرژی و تجهیزات سازمان پتروشیمی	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
--	--	---

Project	BU	Area	20	Phase	VD	Unit	303	Dis.	ME	Doc.	DSH	Seq.	75	Contract No	: 52-98/445	
Owner Document Number :	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 17 OF 20							

○ INSTRUMENTATION

PURCHASER TO FILL IN () AFTER COMMODITY TO INDICATE: BY COMP. MFR. BY PURCH. BY OTHERS

INSTRUMENT & CONTROL PANEL (<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>):	<input checked="" type="radio"/> ONE FOR EA. UNIT <input type="radio"/> ONE COMMON TO ALL UNITS <input type="radio"/> MACHINE MT'ED <input checked="" type="radio"/> FREE STANDING (OFF UNIT) / <input type="radio"/> PNEUMATIC <input type="radio"/> ELEC. <input checked="" type="radio"/> ELECTRONIC <input type="radio"/> HYDRAULIC <input type="radio"/> LOCAL <input checked="" type="radio"/> REMOTE <input type="radio"/> INDOORS <input type="radio"/> NEMA 7, CLASS _____, GROUP IIB _____, DIVISION _____ <input type="radio"/> PROGRAMMABLE CONT'L'R <input checked="" type="radio"/> I/S BARRIERS (<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>) <input type="radio"/> INTRINSICALLY SAFE (Exi) <input type="radio"/> NEMA 4, WATERTIGHT & DUSTTIGHT <input type="radio"/> PURGED TO NFPA 496 TYPE <input type="radio"/> X <input type="radio"/> Y <input type="radio"/> Z <input type="radio"/> OTHER NEMA _____ LOW PURGE PRESS. <input type="radio"/> ALARM <input type="radio"/> SHUTDOWN <input type="radio"/> VIB. ISOLATORS <input type="radio"/> STRIP HEATERS <input type="radio"/> PURGE CONN. <input type="radio"/> EXTRA CUTOUTS <input checked="" type="radio"/> ANNUNCIATOR W/FIRST-OUT INDICATION LOCATED ON CONTROL PANEL <input checked="" type="radio"/> PURCHASER'S CONN. BROUGHT OUT TO TERMINAL BOX BY VENDOR <input checked="" type="radio"/> IP PROTECTION : IP 55 FOR LOCAL PANEL , IP 42 FOR CONTROL INDOOR PANEL. BUFFER GAS CONTROL PANE <input type="radio"/> ONE FOR EA. UNIT <input type="radio"/> ONE COMMON TO ALL UNITS
---	---

INSTRUMENTATION SUITABLE FOR: INDOORS OUTDOORS IP PROTECTION: IP-65 OTHER

PREFERRED INSTRUMENT SUPPLIERS, (TO BE COMPLETED BY PURCHASER), OTHERWISE MFR'S STANDARD APPLIES

	MFR		SIZE & TYPE		MTL
20 PRESSURE GAUGES		as per instrument data sheets			
21 TEMPERATURE GAUGES		as per instrument data sheets			
22 LIQUID LEVEL GAUGES		as per instrument data sheets	TYPE		
23 DIFF. PRESSURE GAUGES		as per instrument data sheets	SIZE & TYPE		
24 PRESS. TRANSMITTERS		as per instrument data sheets	TYPE		
25 LIQUID LEV. TRANSMITTER		as per instrument data sheets	TYPE		
26 PRESSURE SWITCHES		as per instrument data sheets	TYPE		
27 TEMPERATURE SWITCHES		as per instrument data sheets	TYPE		
28 LIQUID LEVEL SWITCHES		as per instrument data sheets	TYPE		
29 DIFF. PRESSURE SWITCHES		as per instrument data sheets	TYPE		
30 CONTROL VALVES		as per instrument data sheets	TYPE		
31 PRESSURE SAFETY VALVES		as per instrument data sheets	TYPE		
32 SIGHT FLOW INDICATORS		as per instrument data sheets	TYPE		
33 VIBRATION MONITORS & EQUIP.		as per instrument data sheets	TYPE		
34 THERMOCOUPLES		as per instrument data sheets	TYPE		
35 RTD'S		as per instrument data sheets	TYPE		
36 SOLENOID VALVES		as per instrument data sheets	TYPE		
37 ANNUNCIATOR			MODEL & (QTY SPARE POINTS)		()
38 PROGRAMMABLE CONTROLLER			TYPE		
39			TYPE		
40			TYPE		

PRESSURE GAUGE REQUIREMENTS LIQUID FILLED PRESSURE GAUGES: YES NO

	LOCALLY MOUNTED	PANEL MOUNTED		LOCALLY MOUNTED	PANEL MOUNTED
45 LUBE OIL MAIN PUMP DISCHAR.	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	PROCESS GAS: INLET PRESS.	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)
46 LUBE OIL AUX. PUMP DISCHARG.	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	@ EA. STAGE	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)
47 LUBE OIL PRESS. AT FRAME HEADER ((<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)			
48 LUBE OIL FILTER Δ P	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	DISCH. PRESS. @ EA. STAGE	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)
49 COOLING H ₂ O INLET HEADER	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)			
50	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)			
51	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)			

52 REMARKS: _____

53

OWNER:  شرکت پترو شیمیایی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--



MC:  شرکت مهندسی و طراحی (مکانیک)	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	
--	--	--

Project	BU	Area	20	Phase	VD	Unit	303	Dis.	ME	Doc.	DSH	Seq.	75	Contract No : 52-98/445
Owner Document Number	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 18 OF 20					

INSTRUMENTATION (CONT'D)												
1												
2	<u>TEMPERATURE MEASUREMENT REQUIREMENTS</u>											
3	<u>FUNCTION</u>											
4												
4	LUBE OIL <input type="radio"/> INLET TO <input type="radio"/> OUT OF FRAME	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
5	LUBE OIL <input type="radio"/> INLET TO <input type="radio"/> OUT OF COOLER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6	MAIN JRNL BEARINGS (THERMOCOUPLES OR RTD'S ONLY)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
7	MOTOR BEARING(S) (THERMOCOUPLES OR RTD'S ONLY)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
8	COOLING WATER HEADER: <input checked="" type="radio"/> INLET <input checked="" type="radio"/> OUTLET	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
9	CYL. COOLING WATER: <input type="radio"/> INLET <input checked="" type="radio"/> OUTLET <input checked="" type="radio"/> EA. CYL	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
10	PROCESS GAS: <input checked="" type="radio"/> INLET <input checked="" type="radio"/> DISCH. <input type="radio"/> EACH CYL	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
11	PROCESS GAS: <input type="radio"/> INLET <input type="radio"/> GAS <input type="radio"/> WATER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
12	INTERCOOLER(S) <input type="radio"/> INLET <input type="radio"/> GAS <input type="radio"/> WATER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
13	<input type="radio"/> INLET <input type="radio"/> GAS <input type="radio"/> WATER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
14	AFTERCOOLER: <input type="radio"/> INLET <input type="radio"/> GAS <input type="radio"/> WATER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
15	<input type="radio"/> INLET <input type="radio"/> GAS <input type="radio"/> WATER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
16	COOLING WATER <input type="radio"/> INLET <input type="radio"/> OUTLET/COOLED PKG CASE(S)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
17	PRESS. PGK CASE, CYL PIST ROD (THRM/CPLS OR RTD'S ONLY)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
18	COMPRESSOR VALVES <input type="radio"/> SUCT. <input type="radio"/> DISCH. TC'S OR RTD'S ONLY	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
19	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

ALARM & SHUTDOWN SWITCH REQ'MTS												
NOTE: ALARM & SHUTDOWN SWITCHES SHALL BE INDIVIDUALLY SEPARATE												
ANNUNCIATION POINTS												
21	ALARM DEVICES											
22	SHUTDOWN DEVICES	<input checked="" type="radio"/> TRANSMITTER										
23		<input checked="" type="radio"/> TRANSMITTER										
24	FUNCTION	ALARM	SHUT DOWN	IN PNL BY MFR	IN CTL ROOM PANEL OTH'RS	IN PNL BY MFR	IN CTL ROOM PANEL OTH'RS	TOTAL NO. OF POINTS				
27	LOW LUBE OIL PRESS. @ BEARING HEADER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	1				
28	HIGH LUBE OIL Δ P ACROSS FILTER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
29	LOW LUBE OIL LEVEL, FRAME	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
30	AUX LUBE OIL PUMP, FAIL TO START	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
31	CYL LUBE SYSTEM PROTECTION	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
32	COMPR. VIBRATION, SHUTDOWN ONLY		(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>					
33	VIBRATION, W/ CONTINUOUS MONITORING	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
34	ROD DROP DETECTOR, CONTACT TYPE(1/CYL)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
35	ROD DROP PROXIMITY PROBE (1/CYL)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
36	OIL TEMP OUT OF FRAME	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
37	HIGH GAS DISCH. TEMP EACH CYLINDER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>					
38	HIGH JACKET WATER TEMP., EA. CYL	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
39	LOW SUCTION PRESS., FIRST STG INLET	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>					
40	HI DISCH. PRESS. <input type="radio"/> FINAL <input checked="" type="radio"/> EA STG	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>					
41	HI CYL. GAS Δ P, EACH STAGE	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
42	HI LIQ. LEV., SEPARATOR	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
43	LOW PURGE GAS PRESS, DISTANCE PIECE(S)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
44	HI X-HD PIN TEMP	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
45	PRESS PKG CASE (PISTON ROD TEMP)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
46	LOW PRESSURE COOLING WATER INLET	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>					
47	TOTAL NUMBER OF ANNUNCIATION POINTS											
48	NOTE: EACH SWITCH SHALL BE MINIMUM SPDT ARRANGEMENT											
49	ALARM CONTACTS SHALL:	<input checked="" type="radio"/> OPEN (DE-ENER.) TO SOUND ALARM & BE ENERGIZED WHEN COMPR. IS IN OPERATION(NORMALLY CLOSE)										
50		<input type="radio"/> CLOSE (ENERGIZE) TO SOUND ALARM & BE DE-ENERGIZED WHEN COMPR. IS IN OPERATION(NORMALLY OPEN)										
51	SHUTDOWN CONTACTS SHALL:	<input checked="" type="radio"/> OPEN (DE-ENERGIZED) TO SHUTDOWN & BE ENERGIZE WHEN COMPR. IS IN OPERATION(NORMALLY CLOSE)										
52		<input type="radio"/> CLOSE (ENERGIZE) TO SHUTDOWN & BE DE-ENERGIZE WHEN COMPR. IS IN OPERATION(NORMALLY OPEN)										
53	REF: 7.6.6.2 FOR MINIMUM RECOMMENDED PROTECTION REQUIREMENTS											

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 
---	--	--

MC:   شرکت سیمان و بتن بوشهر	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)	Contract No : 52-98/445
--	--	--------------------------------

Owner Document Number :	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 19 OF 20
--------------------------------	-----------	-----------	-----------	------------	-----------	------------	-----------	-----------------	-----------------------

INSTRUMENTATION (CONT'D)

1											
2	MISCELLANEOUS INSTRUMENTATION										
3	SIGHT FLOW IND. (COOLING H ₂ O ONLY)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:	<input type="checkbox"/> INTERCLR(S)	<input type="checkbox"/> AFTERCLR	<input type="checkbox"/> OIL CLR	<input type="checkbox"/> H ₂ O CLR				
4	PNEUMATIC PRESSURE TRANSMITTERS	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:	<input type="checkbox"/> CYL JACKET WATER	<input type="checkbox"/> ROD PRESS. PKG CASES						
5	PRESSURE TRANSMITTERS (ELEC. OUTP.)	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:								
6	PNEUMATIC LEVEL TRANSMITTERS	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:								
7	ALARM HORN & ACK'N LMT TEST BUTTON	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:								
8	CONDUIT & WIRING W/JUNCT. BOXES	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	(CON-SOLES)								
9	TEST VALVES	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:								
10	DRAIN VALVES	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:	Coolers							
11	GAUGE GLASS(ES)	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:	Recirculating Oil,							
12	TACHOMETER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:	SPEED RANGE _____ TO _____ RPM							
13	CRANKSHAFT KEY PHASER	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	FOR:								
14	AND TRANSDUCER										
15	LEVEL GAUGE ON SUCTION SUPPRESSOR	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
16	OIL LEVEL SWITCH ON CRAKCASE	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									






17	SEPARATE LUBE OIL CONSOLE INSTRUMENTATION:			PURCH. TO LIST REQ'MTS IN ADDITION TO ANY ABOVE REQ'MTS							
18		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
19		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
20		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
21		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
22		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
23		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									

24	SEPARATE COOLING WATER CONSOLE INSTRUMENT:			PURCH. TO LIST REQ'MTS IN ADDITION TO ANY ABOVE REQ'MTS							
25		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
26		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
27		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
28		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
29		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									
30		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)									

31	RELIEF VALVES									
32	LOCATION	BY	MANUFACTURER	TYPE	◇ SIZE ◇	◇ SETTING ◇				
33	EACH STAGE DISCHARGE	(<input checked="" type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)	TBC		1" / 1 1/2"	26 barg				
34	COOLING WATER OUTLET	(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
35		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
36		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
37		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
38		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
39		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
40		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
41		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								
42		(<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>)								

NOTES:
#1 SEE MOTOR DATA SHEET FOR ADDITIONAL MOTOR INSTRUMENTATION REQUIREMENTS

43
44
45
46
47
48
49
50

OWNER:  شرکت پتروشیمی بوشهر	BUSHEHR PETROCHEMICAL COMPANY MEG PLANT	CONTRACTOR:  Chagalesh-Enerchimi-Steam Joint Venture BUPC-MEG PLANT PROJECT 							
MC:   شرکت پتروشیمی بوشهر	MECHANICAL DATA SHEET FOR EMERGENCY INSTRUMENT AIR COMPRESSOR (20-C-7080)							Contract No : 52-98/445	
Owner Document Number :	BU	20	VD	303	ME	DSH	75	Rev : 00	Page: 20 OF 20

GENERAL NOTES

- (1) COMPRESSOR STARTS BY MEANS OF A LOW-PRESSURE SWITCH ON DELIVERY PIPE AND STOPS WHEN HIGH PRESSURE IS REACHED .
THE REQUIRED LOW/HIGH PRESSURE SWITCHES TO MAINTAIN THE REQUIRED DELIVERY PRESSURE SHALL BE SUPPLIED BY VENDOR .
THE OPERATION IS INTERMITTENT.
- (2) DELETED, VENDOR SHALL PROVIDE AFTER-COOLER .AFTERCOOLER OUTLET GAS TEMPERATURE TO BE 40 DEG C.
- (3) DELETED
- (4) DELETED
- (5) FOR UTILITIES SUPPLY CONDITION AND CLIMATE CONDITION REFER TO "AMBIENT ,SITE CONDITION & UTILITY DATA" , (1216-DE-00-PR-ESS-101)
- (6) MINIMUM METAL TEMPRATURE = 0 DEG C
- (7) DELETED
- (8) DEW POINT AT INLET -170 DEG C, DEW POINT AT ATM. -194.6 DEG C
- 9) TYPE OF COMPRESSOR : VERTICAL
- (10) VENDOR ALSO SHALL PROVIDE BELOW ITEMS:
SPARE PARTS
- (11)GENERAL NOTES :
- A. PROVIDE CONTACTS OPEN FOR CUMULATIVE ALARM AND CUMULATIVE SHUTDOWN .
 - B. PROVIDE SAFETY VALVE ON COMPRESSOR DISCHARGE ,WITH LOCKED OPEN ISOLATING VALVE .
 - C. PROVIDE SEPARATE INSTRUMENT FOR ALARM AND SHUTDOWN.
 - D. THE VENDOR TOGETHER WITH THE INSTRUMENT DOCUMENTATION MUST SUPPLY. A COMPLETE LIST OF ALL THE ALARMS AND INTERLOCKS WITH ALL SET VALUES.
 - E. PROVIDE A VISUAL FLOWMETER ON COOLING WATER RETURN LINE.
 - F. NOISE PRESSURE LEVEL AT 1 M. SHALL BE LESS THAN 85 DB(A)
- (12)VENDOR SHOULD FOLLOW DOC NO.: 1216-DE-00-IN-ESS-603 FOR SPECIFICATION OF APPLICABLE INSTRUMENT.
- (13)PLC PACKAGE SYSTEM (UCP) WILL BE INSTALLED IN CONTROL/AUXILIARY ROOM.
LOCAL PANEL INCLUDING START/STOP PUSH BUTTONS ,LAMPS AND INDICATORS, TRIP RESET PUSH BUTTON ,AMMETER AND ETC
(AS PER PROJECT REQUIREMENTS) WILL BE INSTALLED IN FIELD.
INSTRUMENT WILL BE INSTALLED ON MACHINE OR FREE STANDING.
- (14) DELETED
- (15) THE CAPACITY TO BE SUPPLIED CONSIDERING NO NEGATIVE TOLERANCE. THE REQUIRED CAPACITY (NNT) IS 1.1*50=55 KG/H.